


National PFAS Contamination Coalition




Northeastern University
*Social Science Environmental Health
Research Institute*

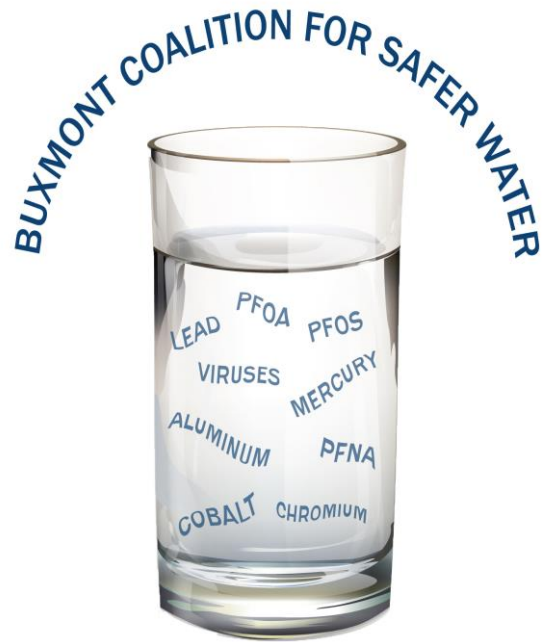

TESTING *for* PEASE

Community Concerns & Challenges: Affected Communities Continue to Expand

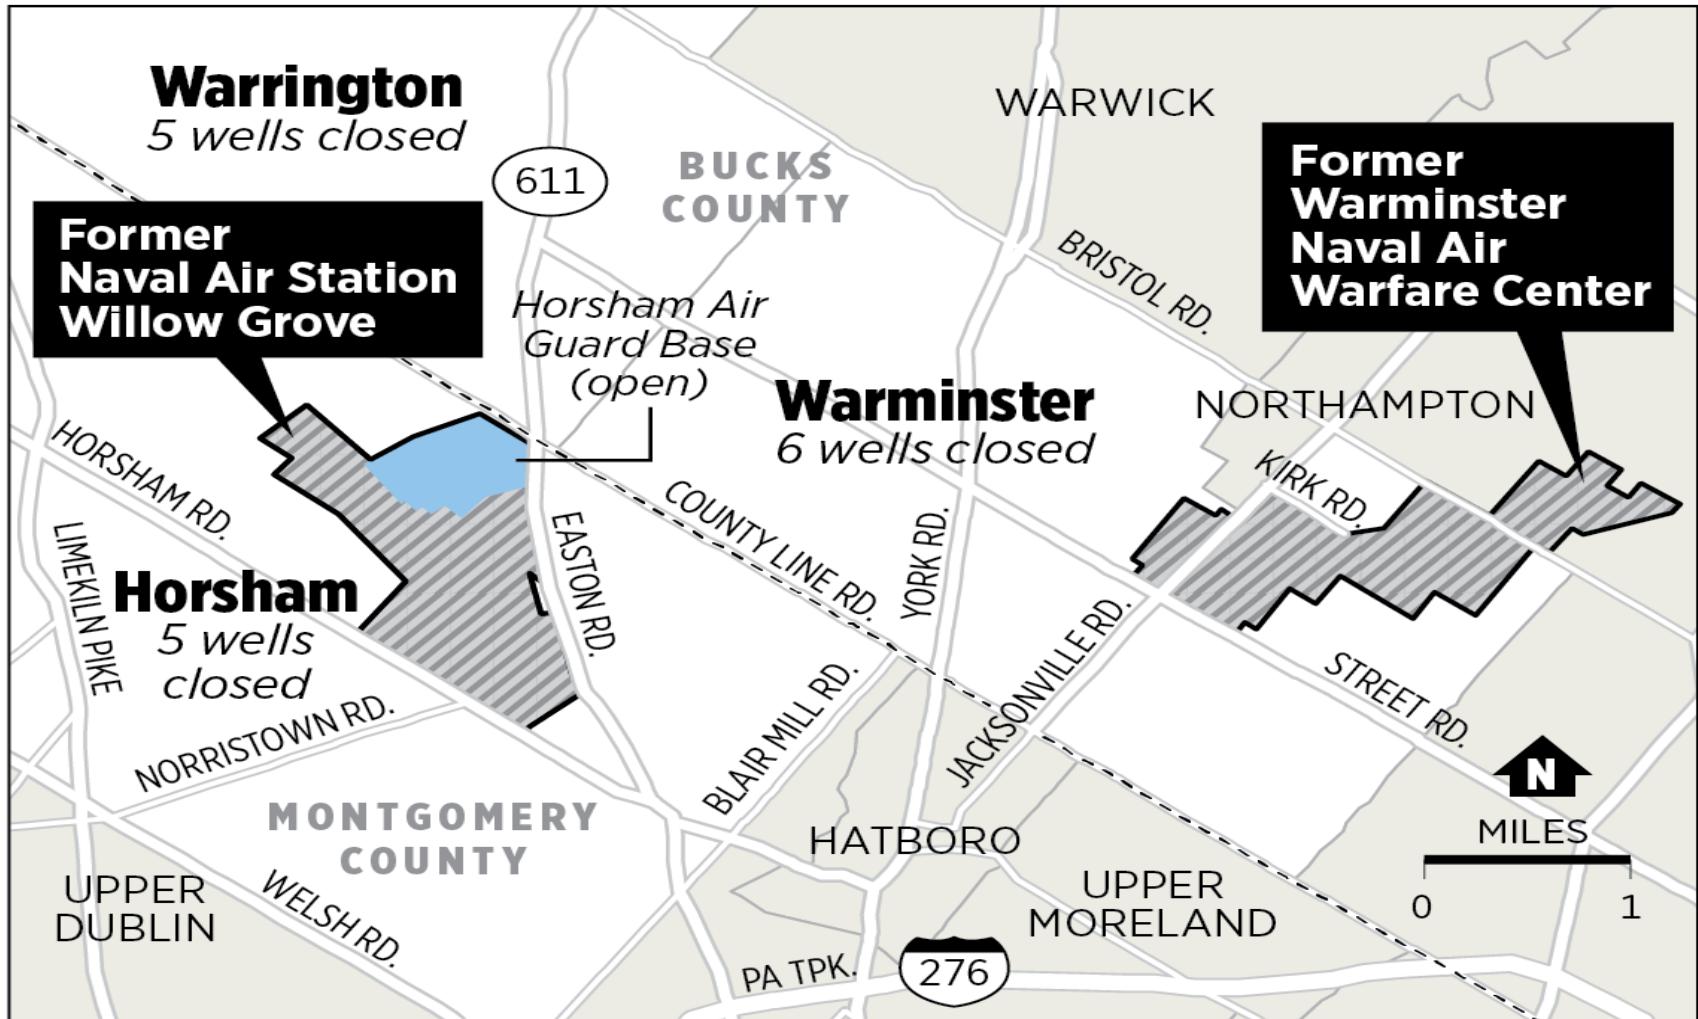

A Closer Look at Our Levels



- Warminster's highest public water **PFOA** level was 350 ppt
- Warminster has **3rd highest** public water **PFOS** level in the U.S.
(1,100 ppt)
- Willow Grove site **on-base** water supply well tested **PFOS** at more than 240 times the EPA's limit (19,000 ppt)
- Willow Grove site ground water samples in 2017 showed **total PFAS** at **4,285 times** the EPA limit (up to **300,000 ppt**)
- The area has recorded among highest public **drinking water** level for **PFOA/PFOS combined** (1,290 ppt)
- All 3 area water utilities are among the top 10 utilities with the highest **PFHxS/PFOS** combined levels sampled in the U.S.

Community Concerns & Challenges:

- Residents deserve blood testing/monitoring
(Limited to PA Dept of Health pilot study)
- Little and slow ground remediation - plumes
- No enforceable state or federal regulations
- Other states are continually issuing more protective limits
- Communities deserve a seat at the table for critical decisions



Community Final Thoughts



Lack of Transparency = Lack of Trust



Lack of Federal and State Regulations

