




Source or Well No.	Sample Collection Date	PFOS Result (ppt <sup>1</sup> )	PFOA Result (ppt)	Combined PFOS PFOA total concentration (ppt)	Combined PFOS PFOA Health Advisory issued 5/19/16 (ppt <sup>2</sup> )	Notes
1	06/24/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
1	12/05/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
1	12/15/2015	6.1	12.0	18.1		
1	05/10/2016	6.8	7.5	14.3		
1	07/27/2016				70.0	well out of service for maintenance
1	08/11/2016	9.2	11.0	20.2	70.0	
1	09/22/2016	8.7	12.0	20.7	70.0	
1	10/12/2016	8.9	11.0	19.9	70.0	
1	10/25/2016	6.3	15.0	21.3	70.0	
1	11/09/2016	9.0	9.6	18.6	70.0	
1	12/14/2016	11.0	12.0	23.0	70.0	
1	01/11/2017	4.6	8.3	12.9	70.0	
1	02/01/2017	16.4	14.8	31.2	70.0	well suspended from service 1/27/17 in accordance with short term plan
1	02/23/2017	8.4	14.8	23.2	70.0	well suspended from service
1	03/09/2017	2.6	2.6	5.2	70.0	well suspended from service
1	03/24/2017	7.6	14.5	22.1	70.0	well suspended from service
1	04/04/2017	19.3	24.6	43.9	70.0	well suspended from service
1	05/03/2017	15.0	21.0	36.0	70.0	well suspended from service
1	05/31/2017		under QC review			well suspended from service
1	06/21/2017	14.3	14.6	28.9	70.0	well suspended from service
1	07/07/2017	17.0	19.0	36.0	70.0	well suspended from service
1	07/21/2017	13.0	16.0	29.0	70.0	well suspended from service
1	08/01/2017	14.0	16.0	30.0	70.0	well suspended from service
1	08/16/2017	16.0	21.0	37.0	70.0	well suspended from service
1	09/07/2017	13.0	19.0	32.0	70.0	well suspended from service
1	09/19/2017	14.0	16.0	30.0	70.0	well suspended from service
1	10/04/2017	13.0	16.0	29.0	70.0	well suspended from service
1	10/17/2017	10.0	19.0	29.0	70.0	well suspended from service
1	11/09/2017	11.0	18.0	29.0	70.0	well suspended from service
1	11/22/2017	11.0	17.0	28.0	70.0	well suspended from service
1	12/05/2017	7.7	20.0	27.7	70.0	well suspended from service
1	12/19/2017	11.0	18.0	29.0	70.0	well suspended from service
1	01/05/2018	11.0	16.0	27.0	70.0	well suspended from service
1	01/16/2018	10.0	16.0	26.0	70.0	well suspended from service
1	02/06/2018	11.0	20.0	31.0	70.0	well suspended from service
1	02/23/2018	15.0	20.0	35.0	70.0	well suspended from service
1	03/08/2018	14.0	21.0	35.0	70.0	well suspended from service
1	04/03/2018	11.0	16.0	27.0	70.0	well suspended from service
1	05/03/2018	11.0	14.0	25.0	70.0	well suspended from service
1	06/05/2018	12.0	18.0	30.0	70.0	well suspended from service
1	07/06/2018	13.0	14.0	27.0	70.0	well suspended from service
1	08/10/2018	8.0	13.0	21.0	70.0	well suspended from service
1	09/06/2018	11.0	21.0	32.0	70.0	well suspended from service
1	10/05/2018	13.0	22.0	35.0	70.0	well suspended from service
1	11/07/2018	13	20	33	70.0	well suspended from service

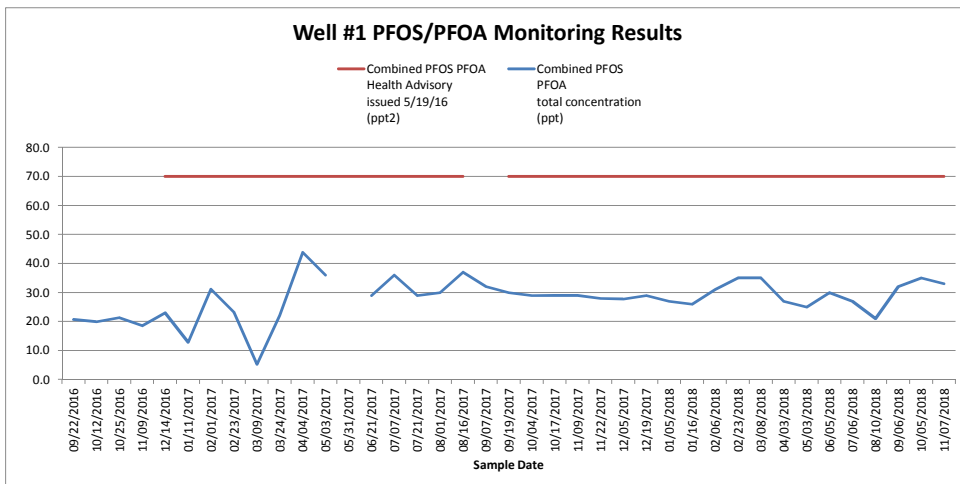

Source or Well No.	Sample Collection Date	PFOS Result (ppt <sup>1</sup> )	PFOA Result (ppt)	Combined PFOS PFOA total concentration (ppt)	Combined PFOS PFOA Health Advisory issued 5/19/16 (ppt <sup>2</sup> )	Notes
2	06/25/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
2	12/12/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
2	12/15/2015	16.0	17.0	33.0		
2	05/10/2016	18.0	10.0	28.0		
2	07/27/2016	23.0	14.0	37.0	70.0	
2	08/10/2016	27.0	16.0	43.0	70.0	
2	09/22/2016	39.0	19.0	58.0	70.0	
2	10/12/2016	21.0	16.0	37.0	70.0	
2	10/25/2016	20.0	22.0	42.0	70.0	
2	11/09/2016	21.0	14.0	35.0	70.0	
						well suspended from service 11/18/16 in accordance with short term plan
2	12/14/2016	14.0	9.6	23.6	70.0	
2	01/11/2017	9.6	9.1	18.7	70.0	well suspended from service
2	02/01/2017	18.3	10.2	28.5	70.0	well suspended from service
2	02/23/2017	11.1	8.7	19.8	70.0	well suspended from service
2	03/09/2017	16.0	8.7	24.7	70.0	well suspended from service
2	03/24/2017	12.1	10.2	22.3	70.0	well suspended from service
2	04/04/2017	19.4	9.7	29.1	70.0	well suspended from service
2	05/03/2017	27.0	12.0	39.0	70.0	well suspended from service
2	05/31/2017	29.0	12.0	41.0	70.0	well suspended from service
2	06/21/2017	28.6	12.0	40.6	70.0	well suspended from service
2	07/07/2017	29.0	16.0	45.0	70.0	well suspended from service
2	07/21/2017	30.0	14.0	44.0	70.0	well suspended from service
2	08/01/2017	25.0	11.0	36.0	70.0	well suspended from service
2	08/16/2017	29.0	11.0	40.0	70.0	well suspended from service
2	09/07/2017	29.0	11.0	40.0	70.0	well suspended from service
2	09/19/2017	24.0	10.0	34.0	70.0	well suspended from service
2	10/04/2017	24.0	9.78	33.8	70.0	well suspended from service
2	10/17/2017	28.0	11.0	39.0	70.0	well suspended from service
2	11/09/2017	22.0	10.0	32.0	70.0	well suspended from service
2	11/22/2017	18.0	8.7	26.7	70.0	well suspended from service
2	12/05/2017	15.0	11.0	26.0	70.0	well suspended from service
2	12/19/2017	20.0	9.9	29.9	70.0	well suspended from service
2	01/05/2018	22.0	10.0	32.0	70.0	well suspended from service
2	01/16/2018	20.0	11.0	31.0	70.0	well suspended from service

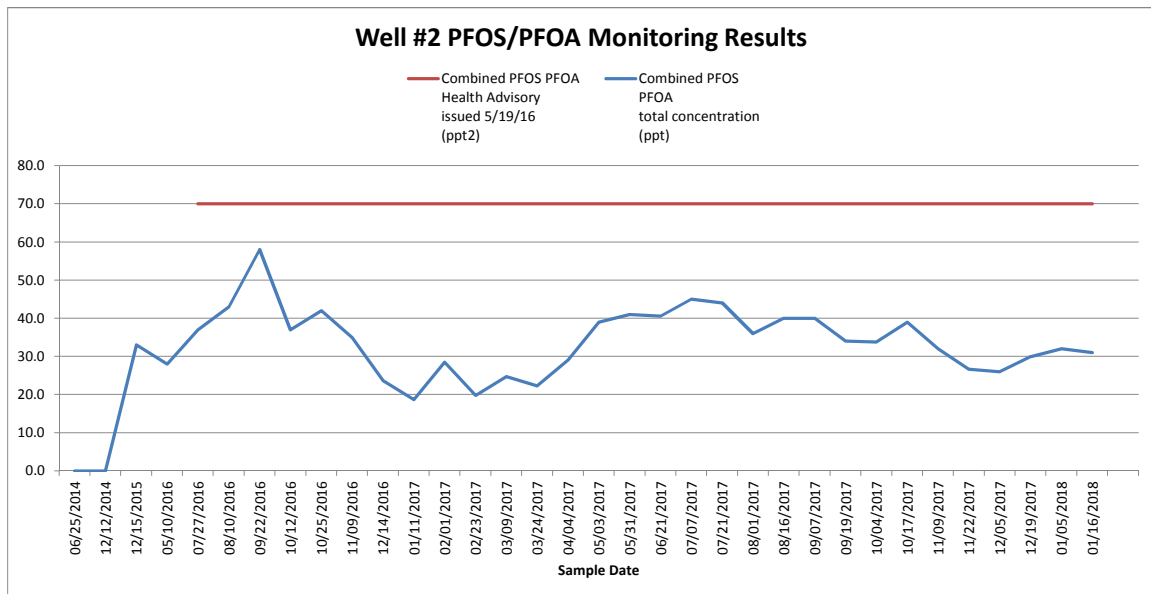


Source or Well No.	Sample Collection Date	PFOS Result (ppt <sup>1</sup> )	PFOA Result (ppt)	Combined PFOS PFOA total concentration (ppt)	Combined PFOS PFOA Health Advisory issued 5/19/16 (ppt <sup>2</sup> )	Notes
3	06/25/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
3	12/10/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
3	12/15/2015	3.3	7.4	10.7		
3	05/10/2016	7.0	6.1	13.1		
3	07/27/2016	8.4	6.2	14.6	70.0	
3	08/10/2016	11.0	8.4	19.4	70.0	
3	09/22/2016	4.9	8.4	13.3	70.0	
3	10/12/2016	7.4	8.4	15.8	70.0	
3	10/25/2016	4.6	8.8	13.4	70.0	
3	11/09/2016	7.0	7.0	14.0	70.0	
3	12/14/2016	6.8	7.0	13.8	70.0	
3	01/11/2017	4.2	6.2	10.4	70.0	
3	02/01/2017	12.2	9.3	21.5	70.0	
3	02/23/2017	4.6	6.7	11.3	70.0	
3	03/09/2017	8.0	6.9	14.9	70.0	
3	03/24/2017	5.8	8.4	14.2	70.0	
3	04/04/2017	10.2	9.6	19.8	70.0	
3	05/02/2017	13.0	9.1	22.1	70.0	well suspended from service 4/6/17
3	05/31/2017	12.0	12.0	24.0	70.0	in accordance with short term plan
3	06/21/2017	10.1	10.2	20.3	70.0	well suspended from service
3	07/07/2017	16.0	15.0	31.0	70.0	well suspended from service
3	07/21/2017	12.0	13.0	25.0	70.0	well suspended from service
3	08/01/2017	13.0	13.0	26.0	70.0	well suspended from service
3	08/16/2017	15.0	16.0	31.0	70.0	well suspended from service
3	09/19/2017	15.0	12.0	27.0	70.0	well suspended from service
3	10/04/2017	14.0	4.9	18.9	70.0	well suspended from service
3	10/17/2017	12.0	14.0	26.0	70.0	well suspended from service
3	11/09/2017	13.0	13.0	26.0	70.0	well suspended from service
3	11/22/2017	11.0	12.0	23.0	70.0	well suspended from service
3	12/05/2017	9.0	12.0	21.0	70.0	well suspended from service
3	12/19/2017	13.0	12.0	25.0	70.0	well suspended from service
3	01/05/2018	11.0	14.0	25.0	70.0	well suspended from service
3	01/16/2018	12.0	13.0	25.0	70.0	well suspended from service
3	02/06/2018	13.0	13.0	26.0	70.0	well suspended from service
3	02/23/2018	12.0	14.0	26.0	70.0	well suspended from service
3	06/05/2018	14.0	14.0	28.0	70.0	well suspended from service
3	07/06/2018	15.0	14.0	29.0	70.0	well suspended from service
3	08/10/2018	5.6	8.2	13.8	70.0	well suspended from service
3	09/06/2018	3.0	12.0	15.0	70.0	well suspended from service
3	10/05/2018	11.0	11.0	22.0	70.0	well suspended from service
3	11/07/2018	11.0	14.0	25.0	70.0	well suspended from service

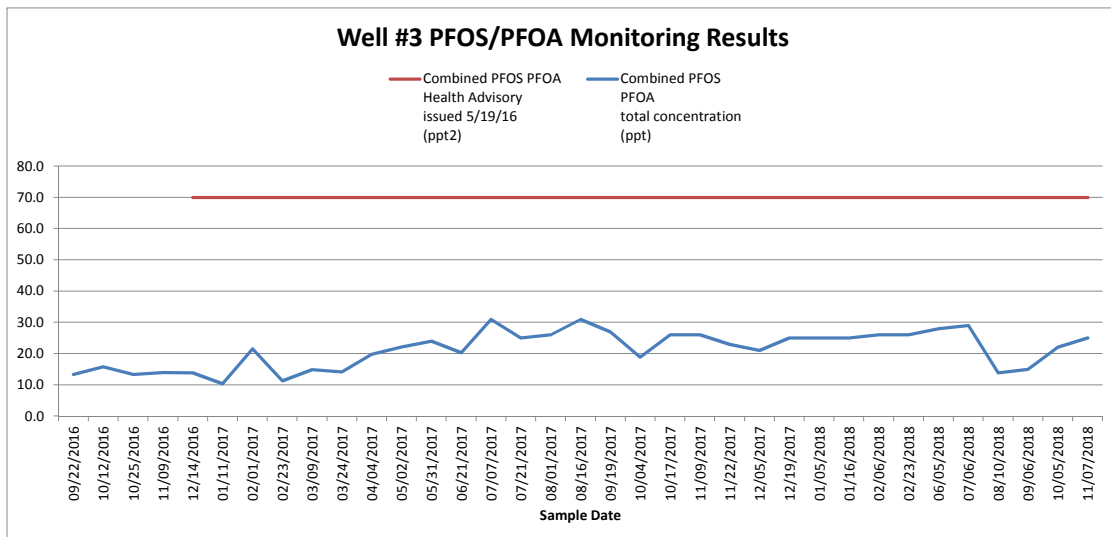


## Well 4 - Inactive

Source or Well No.	Sample Collection Date	PFOS Result (ppt <sup>1</sup> )	PFOA Result (ppt)	Combined PFOS PFOA total concentration (ppt)	Combined PFOS PFOA Health Advisory issued 5/19/16 (ppt <sup>2</sup> )	Notes
4	06/25/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
4	12/08/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
4	12/15/2015	8.4	9.1	17.5		
4	05/10/2016	10.0	6.3	16.3		
4	07/27/2016	17.0	5.9	22.9	70.0	
4	08/10/2016	18.0	9.2	27.2	70.0	
4	09/22/2016	13.0	10.0	23.0	70.0	
4	10/12/2016	16.0	10.0	26.0	70.0	
4	10/25/2016	15.0	8.8	23.8	70.0	
4	11/09/2016	15.0	8.9	23.9	70.0	
4	12/14/2016	14.0	7.5	21.5	70.0	
4	01/11/2017	8.8	6.9	15.7	70.0	
4	02/01/2017	22.2	9.6	31.8	70.0	
4	03/08/2017	15.0	8.7	23.7	70.0	
4	04/04/2017	14.7	9.6	24.3	70.0	
4	05/02/2017	17.0	10.0	27.0	70.0	
4	05/31/2017	19	5.8	24.8	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	06/21/2017	14.9	6	20.9	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	07/07/2017	18.0	7.8	25.8	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	07/21/2017	18.0	7.5	25.5	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	08/01/2017	18.0	7.2	25.2	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	08/16/2017	15.0	6.9	21.9	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	09/07/2017	15.0	5.3	20.3	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	09/19/2017	16.0	6.0	22.0	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	10/04/2017	18.0	5.9	23.9	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	10/17/2017	18.0	6.1	24.1	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	11/09/2017	18.0	5.6	23.6	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	11/22/2017	14.0	5.4	19.4	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	12/05/2017	14.0	5.5	19.5	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	12/19/2017	18.0	6.9	24.9	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	01/05/2018	18.0	6.5	24.5	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	01/16/2018	12.0	13.0	25.0	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	02/06/2018	16.0	5.1	21.1	70.0	well suspended from service 5/8/17 in accordance with short term plan
4	02/22/2018	well station under construction for permanent treatment system installation, can no longer sample				well under construction in accordance with long term plan


Source or Well No.	Sample Collection Date	PFOS Result (ppt <sup>1</sup> )	PFOA Result (ppt)	Combined PFOS PFOA total concentration (ppt)	Combined PFOS PFOA Health Advisory issued 5/19/16 (ppt <sup>2</sup> )	Notes
--------------------	------------------------	---------------------------------	-------------------	--	---	-------

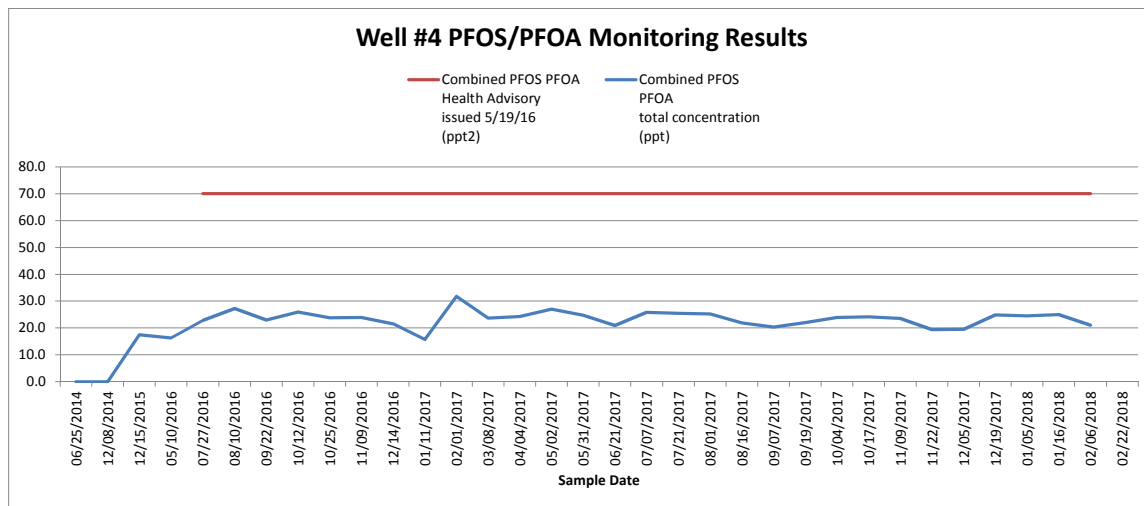

Source or Well No.	Sample Collection Date	PFOS Result (ppt <sup>1</sup> )	PFOA Result (ppt)	Combined PFOS PFOA total concentration (ppt)	Combined PFOS PFOA Health Advisory issued 5/19/16 (ppt <sup>2</sup> )	Notes
19	06/24/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
19	12/08/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
19	12/15/2015	6.4	9.2	15.6		
19	05/10/2016	7.8	6.3	14.1		
19	07/27/2016	12.0	7.5	19.5	70.0	
19	08/10/2016	14.0	8.6	22.6	70.0	
19	09/22/2016	10.0	9.5	19.5	70.0	
19	10/12/2016	13.0	9.6	22.6	70.0	
19	10/25/2016	10.0	8.4	18.4	70.0	
19	11/09/2016	12.0	9.0	21.0	70.0	
19	12/01/2016	12.0	7.7	19.7	70.0	
19	01/11/2017	6.8	6.7	13.5	70.0	
19	02/01/2017	17.4	9.8	27.2	70.0	
19	02/14/2017		well pump removed			well suspended from service 2/8/17 in accordance with short term plan

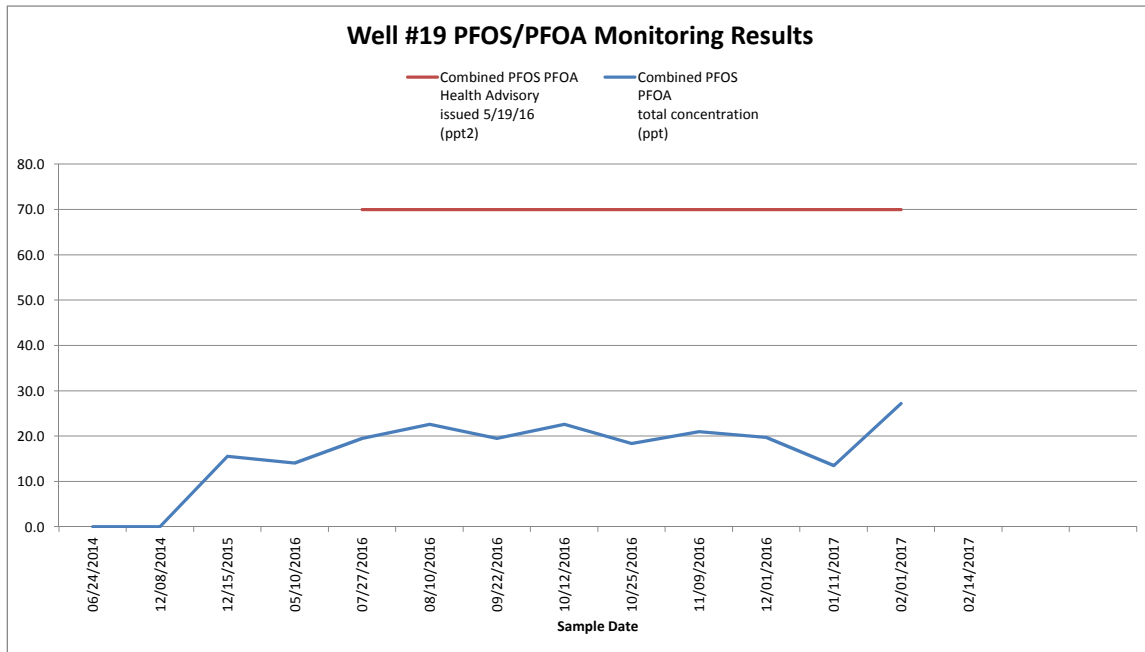

Source or Well No.	Sample Collection Date	PFOS Result (ppt <sup>1</sup> )	PFOA Result (ppt)	Combined PFOS PFOA total concentration (ppt)	Combined PFOS PFOA Health Advisory issued 5/19/16 (ppt <sup>2</sup> )	Notes
20	06/24/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
20	12/12/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
20	12/15/2015	12.0	14.0	26.0		
20	05/10/2016	11.0	9.0	20.0		
20	07/27/2016	19.0	13.0	32.0	70.0	
20	08/10/2016	21.0	14.0	35.0	70.0	
20	09/22/2016	17.0	15.0	32.0	70.0	
20	10/12/2016	23.0	17.0	40.0	70.0	
20	10/25/2016	26.0	20.0	46.0	70.0	
20	11/09/2016	27.0	16.0	43.0	70.0	
20	12/01/2016	24.0	15.0	39.0	70.0	
						well suspended from service 12/15/16 in accordance with short term plan
20	01/11/2017	10.2	8.2	18.4	70.0	
20	02/01/2017	10.7	6.8	17.5	70.0	well suspended from service
20	02/23/2017	5.2	5.6	10.8	70.0	well suspended from service
20	03/01/2017	well station under construction for permanent treatment system installation, can no longer sample				well under construction in accordance with long term plan

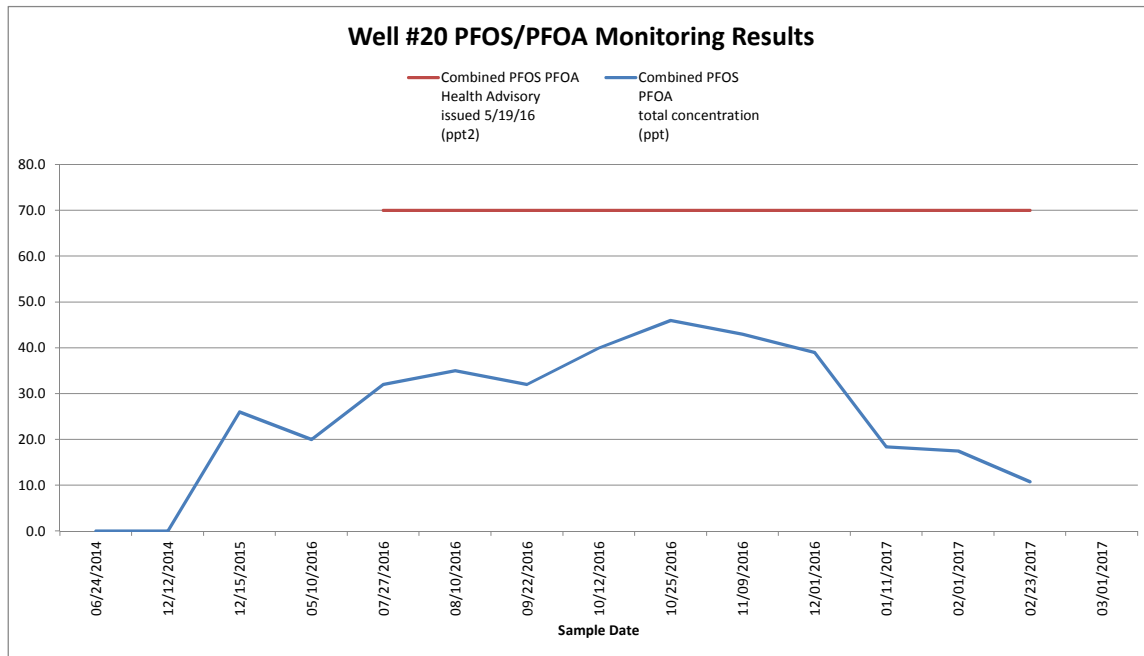


## Well 22 - Inactive

Source or Well No.	Sample Collection Date	PFOS Result (ppt <sup>1</sup> )	PFOA Result (ppt)	Combined PFOS PFOA total concentration (ppt)	Combined PFOS PFOA Health Advisory issued 5/19/16 (ppt <sup>2</sup> )	Notes
22	12/08/2014	ND <sup>3</sup>	ND <sup>3</sup>	ND <sup>3</sup>		
22	12/15/2015	0.0	0.0	0.0		
22	05/10/2016	10.0	9.4	19.4		
22	07/27/2016	14.0	12.0	26.0	70.0	
22	08/10/2016	15.0	14.0	29.0	70.0	
22	09/22/2016	9.1	9.8	18.9	70.0	
22	10/12/2016	14.0	14.0	28.0	70.0	
22	10/25/2016	14.0	18.0	32.0	70.0	
22	11/09/2016	15.0	20.0	35.0	70.0	
22	12/01/2016	13.0	11.0	24.0	70.0	
22	01/11/2017	8.2	11.4	19.6	70.0	
22	02/01/2017	13.2	10.4	23.6	70.0	
22	02/23/2017		under QC review			
22	03/08/2017	14.0	13.0	27.0	70.0	
22	03/24/2017	15.6	13.1	28.7	70.0	
22	04/04/2017	15.2	14.6	29.8	70.0	
22	05/03/2017	15.0	15.0	30.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	06/21/2017	19.1	14.2	33.3	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	07/07/2017	22.0	19.0	41.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	07/21/2017	23.0	18.0	41.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	08/01/2017	22.0	18.0	40.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	08/16/2017	21.0	18.0	39.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	10/04/2017	20.0	18.0	38.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	10/17/2017	12.0	16.0	28.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	11/09/2017	16.0	16.0	32.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	11/22/2017	17.0	16.0	33.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	12/05/2017	18.0	15.0	33.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	12/19/2017	16.0	15.0	31.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	01/05/2018	18.0	16.0	34.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	01/16/2018	15.0	16.0	31.0	70.0	well suspended from service 5/3/17 in accordance with short term plan
22	well station under construction for permanent treatment system installation, can no longer sample					well under construction in accordance with long term plan



Source or Well No.	Sample Collection Date	PFOS Result (ppt <sup>1</sup> )	PFOA Result (ppt)	Combined PFOS PFOA total concentration (ppt)	Combined PFOS PFOA Health Advisory issued 5/19/16 (ppt <sup>2</sup> )	Notes
--------------------	------------------------	---------------------------------	-------------------	--	---	-------

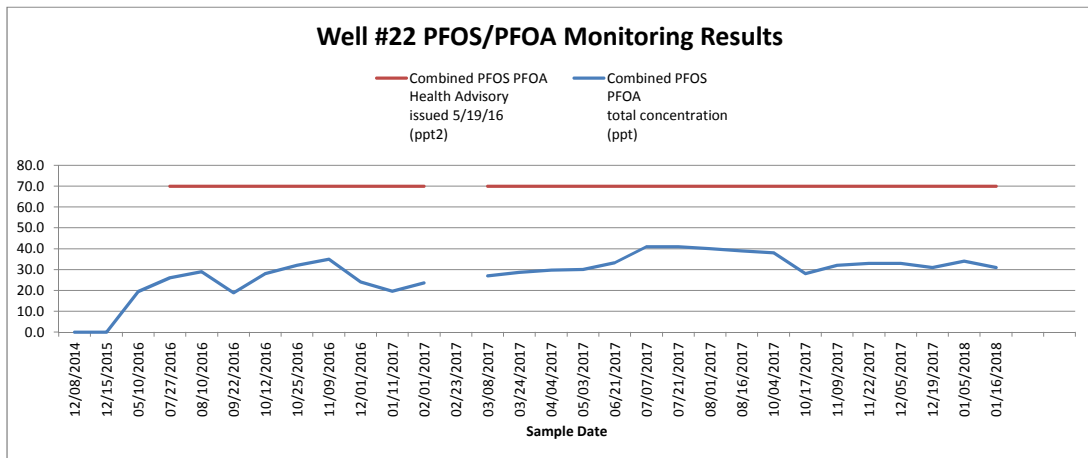

<sup>1</sup> Parts Per Trillion - equivalent to ng/L (nanograms per liter).

<sup>2</sup> The Health Advisory was issued on May 19, 2016 as 70 parts per trillion.

<sup>3</sup> ND - Not Detected - Results below laboratory minimum reporting limit of 40 ppt for PFOS & 20 ppt for PFOA

<sup>4</sup> ND - Not Detected - Results below laboratory minimum reporting limit of 30 ppt for PFOA

<sup>5</sup> ND - Not Detected - Results below laboratory minimum reporting limit of 2.5 ppt for each PFOS & PFOA unless diluted

<sup>6</sup> ND - Not Detected - Results below laboratory minimum reporting limit of 4 ppt for PFOS

<sup>7</sup> ND - Not Detected - Results below laboratory minimum reporting limit of 2 ppt for PFOA

<sup>8</sup> samples were collected at a distribution site representative of the interconnect

<sup>9</sup> ND - Not Detected - Results below laboratory minimum reporting limit of 2.4 ppt for each PFOS & PFOA

<sup>10</sup> ND - Not Detected - Results below laboratory minimum reporting limit of 2.0 ppt for each PFOS & PFOA

green text indicates EPA UCMR3 compliance sample

red text indicates well was not supplying system at the time the sample was taken