


COPPER PIPE

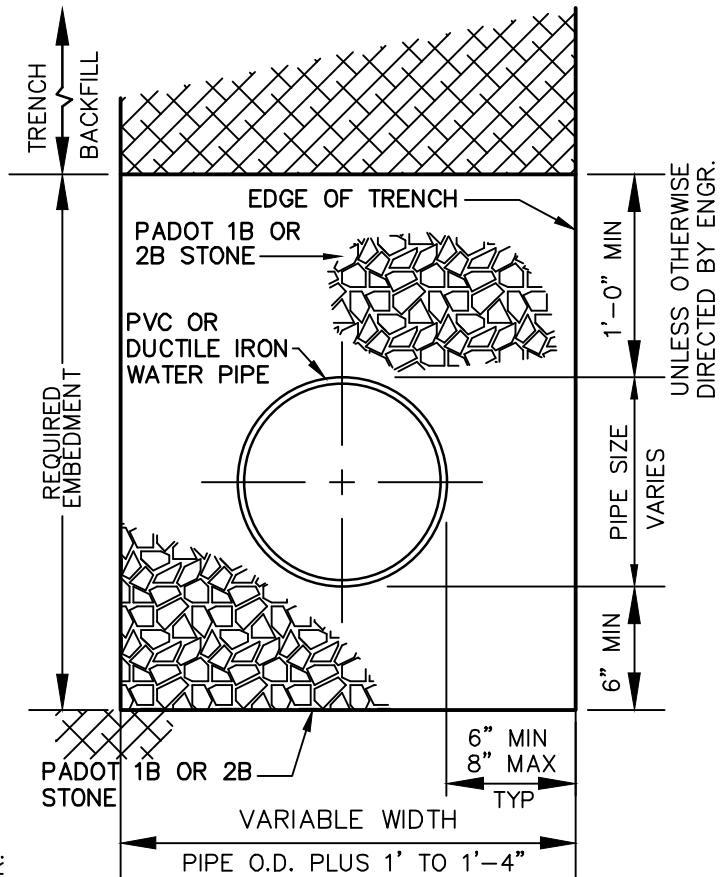

PVC PIPE OR DUCTILE IRON PIPE

NOTES:

1. 2A COARSE AGGREGATE MAY BE USED FOR EMBEDMENT OF DUCTILE IRON PIPE.
2. FOR UTILITY TRENCH RESTORATION DETAILS REFER TO SANITARY SEWER STANDARD DETAILS.

HORSHAM WATER & SEWER AUTHORITY

DETAIL W20

**WATER PIPE EMBEDMENT
DETAILS**

DATE:
MARCH 23, 2015

SCALE:
NOT TO SCALE