


SECURE PIPE USING
#5 STEEL REINFORCING
RODS W/ WIRE, SPACED
AS REQUIRED TO PREVENT
PIPE FLOATATION

2,000 P.S.I. CONCRETE
(PENNDOT CLASS 'C')
OR HIGH EARLY STRENGTH
CONCRETE AT CONTRACTOR'S
DISCRETION

WATER
PIPE

PROVIDE MASONRY SUPPORT
AS REQUIRED TO PREVENT
PIPE MOVEMENT

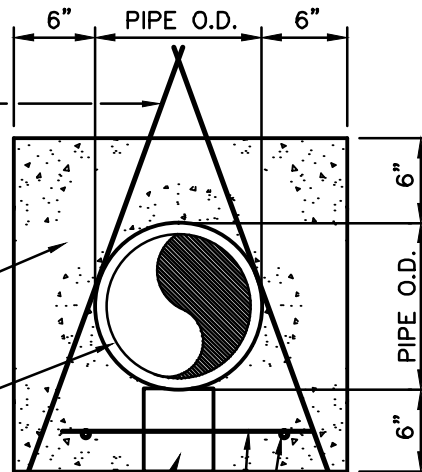

#4 CONTINUOUS
#4 @ 1'-6"

NOTES:

1. PROVIDE REINFORCEMENT AT UTILITY CROSSINGS ONLY.

HORSHAM WATER & SEWER AUTHORITY

DETAIL W24

**CONCRETE
ENCASEMENT DETAIL**

DATE:
MARCH 23, 2015

SCALE:
NOT TO SCALE