


PLAN

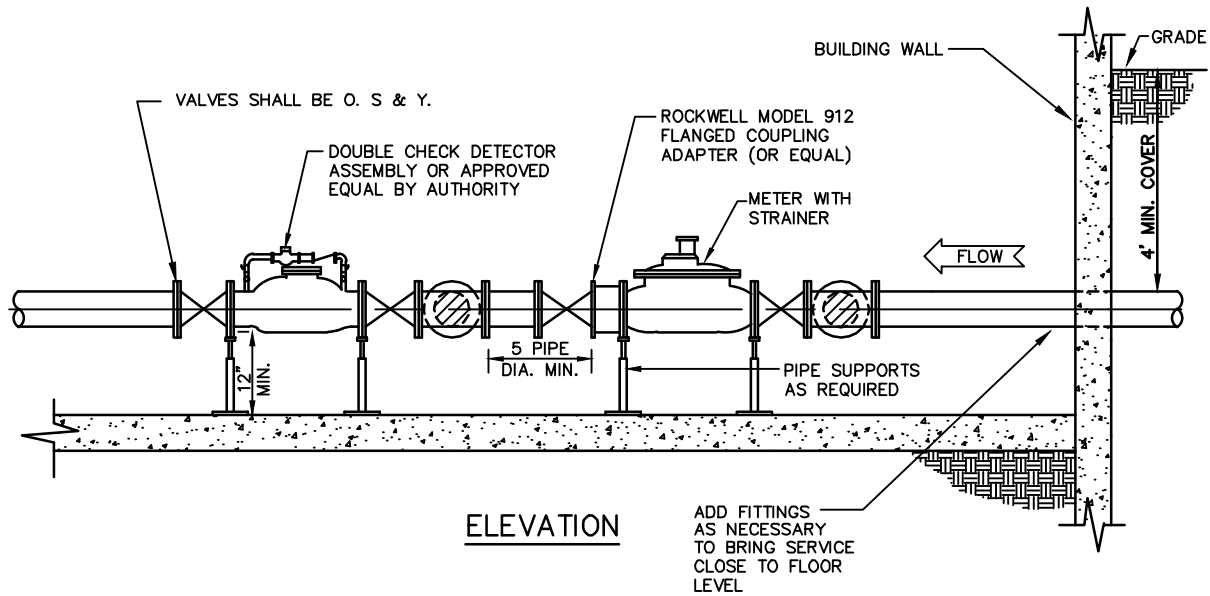

ELEVATION

NOTES:

1. SIZE OF PIPING SAME AS FIRST FIGURE IN DETECTOR CHECK SIZE.
2. ALL VALVES CONTROLLING CONNECTIONS TO WATER SUPPLIES AND TO SUPPLY PIPES TO SPRINKLERS SHALL BE LISTED INDICATING VALVES.
3. RPZ BACKFLOW ASSEMBLY MAY BE REQUIRED FOR CERTAIN APPLICATIONS. RPZ TO BE INSTALLED ON SERVICE LINE AT ENTRY POINTS INTO BUILDING BEFORE ANY CONNECTIONS AND AFTER METER.
4. PROVIDE ELECTRICAL BONDING AS REQUIRED BY CODE.

HORSHAM WATER & SEWER AUTHORITY

DETAIL W8

**STANDARD INSIDE
INSTALLATION FOR
METERS > 1"**

DATE:
MARCH 23, 2015

SCALE:
NOT TO SCALE